



SITE ESTIMATING SHEET

PROJECT NAME: [] Date: []

Address / Location: []

Estimated Project Date: []

Project Industry: []

System Integrator/Dealer

Customer / End User

Company []
Address []
City/State/Country []
Contact Name []
Telephone []
Email / Fax []

Company []
Address []
City/State/Country []
Contact Name []
Telephone []
Email / Fax []

SITE CHARACTERISTICS

In order to provide an accurate and cost effective estimate, please provide all applicable information.

- 1. Preferred Detection Type: [] Fence [] Buried Cable [] Microwave Perimeter Total Length: []
2. Number of Gates (note size and location on drawing): Swing Gate: [] Sliding Gate: []
3. If slide gate or gated road, preferred sensor type: [] Microwave [] Infrared [] Gate Contact

FENCE DETECTION

4. Fence Height: [] Fence Material: [] Chain Link [] Weld Mesh [] Expanded Metal [] Other []

BURIED CABLE DETECTION

- 5. Fenceline: [] Single [] Dual Distance Between Fences: []
6. Clear Zone Space Width: [] Corner Radius: []
7. Location Depth: AC Power: [] Water / Sewer Lines: [] Water Drainage: []
8. Asphalt or Concrete Roadway Requirements: Roadway Saw Cut Distance: [] Depth: []

MICROWAVE DETECTION

- 9. Clear Zone Space Width: [] Distance Between Fences: [] Corner Radius: []
10. Terrain Flatness in Zone +/- 7.6 cm (3 in): [] Required Detection Height (stacked): []

MONITORING DETAILS


- 11. Type of Alarm Monitoring: [] Local Panel / Relays [] PC Graphic Display [] Third Party Interface: []
12. Monitoring Location (note on drawing): [] On Site [] Remote / Central Station [] Both
13. Alarm Interface Type: [] Alarm Panel Relays [] CCTV Pre-Sets [] Both
14. AC Power Location: [] Security Center [] Guard Station [] Equipment Room [] Other []
15. Number of zones (relay module, dry relay outputs only) required for CCTV: Zones: [] AUX Zones: []
16. Type of communication used: [] Copper [] Fiber [] IP [] Other []

Special Requirements: []

SITE DIAGRAM

Provide a sketch below or attach a drawing of the proposed site (Auto CAD). Below is a checklist of the information required for Southwest Microwave to provide an accurate and complete list of materials for a quotation.

- Perimeter dimensions
- Gate locations
- Types of gates
- Auxiliary gate sensors
- Location of AC source
- Monitoring location
- Location of buildings on site
- Dimensions of gates

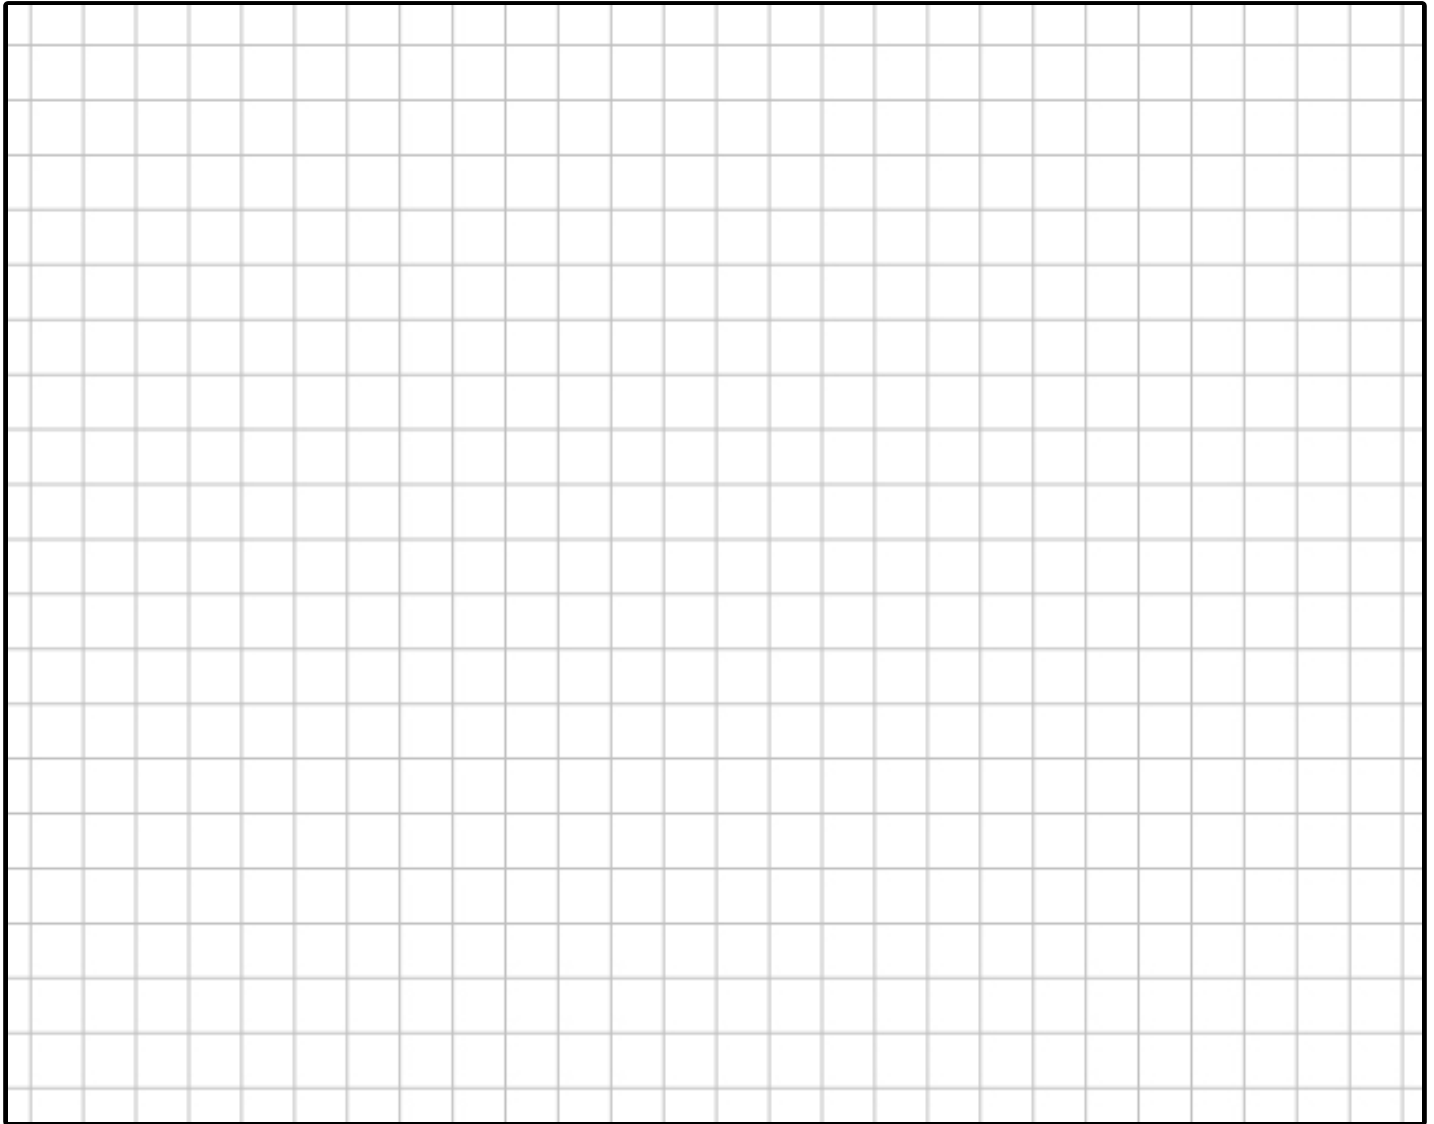

Items necessary for a complete installation include, but not limited to:

- Installation labor:
 - MicroPoint™/ MICRONET™: 1 man/day per PM
 - MicroTrack™: 2 man/day per MTP
 - Microwave: 0.5 man/day per MW
- Laptop PC with Windows 7 Pro, 8 Pro or 10 Pro
- Data communication shielded wire (Belden # 8303 or equivalent) for RS422
- Power Supply 24VDC 3A or 48VDC 3A

E-mail completed forms to your designated Project Manager or to infosd@southwestmicrowave.com

CORPORATE HEADQUARTERS: SOUTHWEST MICROWAVE, INC.

9055 S. MCKEMY ST. | TEMPE, ARIZONA 85284 USA | TEL +1 480 783 0201 | INFOSD@SOUTHWESTMICROWAVE.COM

EUROPEAN OFFICES: SOUTHWEST MICROWAVE LTD.

SUITE 3, DEER PARK BUSINESS CTR | WOOLLAS HILL, ECKINGTON, WORCESTERSHIRE WR10 3DN UK | TEL +44 (0) 1386 75 15 11